


Maharashtra State Public Health Service

School of Public Health Experiments Konkan Bhavan, Telephone No. (022) 27571981 e-mail : jsophikon@gmail.com

MICROBIAL REPORTING OF WATER SAMPLES


To :- Amity International School Plot No. 81, Sector -15 CBD
Belapur Navi Mumbai
Senders letter No. :- 6/1/2023
Ref. No. of Experiments :-284

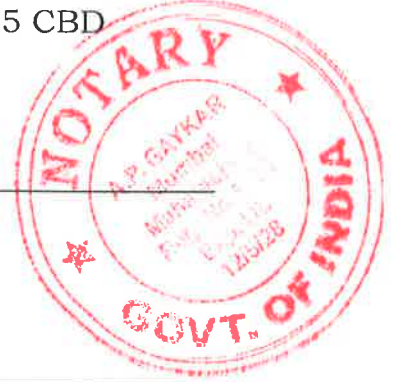

Date of Sampling : 6/1/2023
Date of arrival of Sample : 6/1/2023
Date of commencement of examination : 6/1/2023

Sr. No.	Description of Sample	Conclusion Of Inspection			Other feedback
		Coilforms	Thermotolerant Coliforms	E. Coli	
		PER 100 ML POTENTIAL MICROBES NUMBER			
1]	Water Sample Rs.340/- 2274206 6/1/2023	0	-	-	Suitable to drink (Potable)

The above sample was not collected by the laboratory
The results are for saturated sample only
Comment;- The non-potable water can be used for drinking purpose only after proper chlorination and complete microbiological testing.
Report No. :- 133 date :12/5/23
Date of Communication by Feedback letter :-

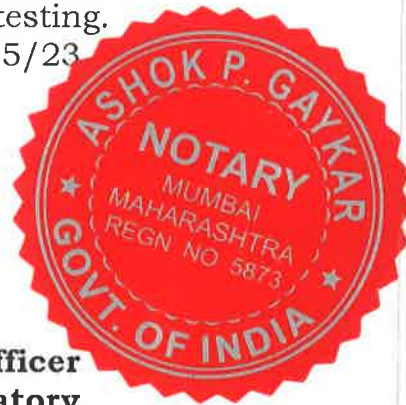

Copy submitted to :
1. Surgeon, District Hospital, District

Sd/-
**Junior Scientific Officer
Public Health Laboratory,
Konkan Bhavan**

Aishwarya
Manager
Amity International School, Navi Mumbai

Sd/- Ashoka Education Foundation


Translated by Adv. G. N. Surywanshi

ATTESTED BY ME

Adv. ASHOK P. GAYKAR
B.Com., LL.B., G.D.C. & A.
NOTARY GOVT. OF INDIA
Reg. No. 5873.

20 SEP 2023

Principal
AMITY INTERNATIONAL SCHOOL
CBD Belapur, Navi Mumbai

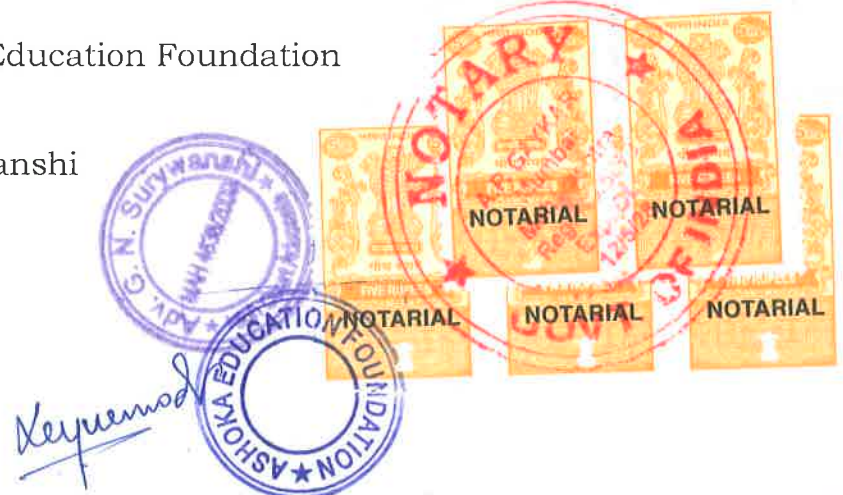

महाराष्ट्र राज्य सार्वजनिक आरोग्य सेवा
सार्वजनिक आरोग्य प्रयोग शाळा कोकणभवन, दूरध्वनी क्रमांक (०२२) २७५७१९८१
e-mail : jsophikon@gmail.com

पाणी नमुन्यांचा सूक्ष्मजीवीय अहवाल

प्रती :- Amity International School Plot no 81 Sect-25
CBD Belapur (W) Mumbai
पाठविणार्याचे पत्र क्रमांक :- 6/11/2023
प्रयोगशाळा संदर्भ क्रमांक :- 284

नमुना घेतल्याचा दिनांक :- 6/11/2023
नमुना पोहचल्याचे दिनांक :- 6/11/2023
परीक्षण सुरू केल्याचा दिनांक :- 6/11/2023

अ. क्र.	नमुन्यांचे विवरण	परिक्षणाचे निष्कर्ष			इतर. अभिप्राय
		प्रती १०० मि. ली संभाव्य सूक्ष्मजंतूंची संख्या			
		कोलिफॉर्मस	थर्मोटॉलरन्ट कोलिफॉर्मस	इ. कोलाय	
1)	Water sample NS 3401 2274206 6/11/2023	0	—	—	पिण्यास योग्य (Potable)

(The above sample was not collected by laboratory
The results are for submitted sample only)

अभिप्राय:- पिण्यास अयोग्य पाण्यावर योग्य प्रमाणत क्लोरिनची प्रक्रिया केल्यानंतर व सूक्ष्मजीवीय पुर्णतपासणी नंतर पिण्यास योग्य असल्याची खात्री झाल्यानंतर ते पाणी पिण्यासाठी वापरत येईल.

अहवाल क्रमांक:- 133

अभिप्राय तारेने कळविण्याचा दिनांक:-

दिनांक:-

12/1/23

प्रत सादर:

१. शस्त्रचिकित्सक, जिल्हा रुग्णालय, जिल्हा

Manager

Amity International School, Navi Mumbai

कनिष्ठ वैज्ञानिक अधिकारी
सार्वजनिक आरोग्य प्रयोगशाळा
कोकण भवन

